Trouble Shooting the RAS System at Hagerman NFH

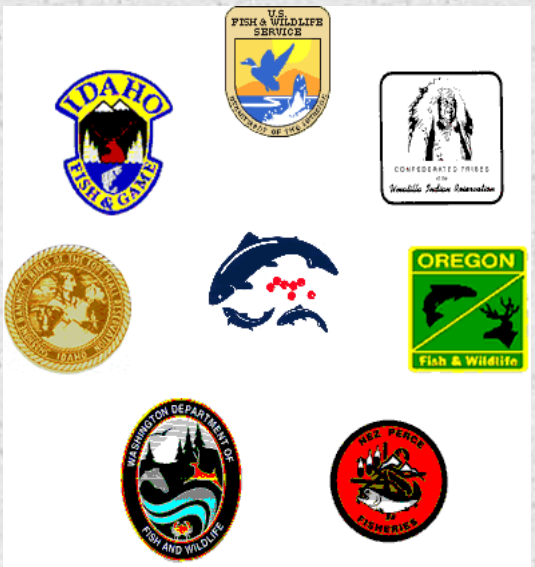

BONNEVILLE POWER ADMINISTRATION

Tanks

Old

8.0mg/L
ID: 3 DO (mg/L)
P4 RIU
remote interface unit
www pointfour.com

New

PENTAIR
AQUATIC ECO-SYSTEMS
6.5mg/L
POINT FOUR™ RIU3
REMOTE INTERFACE UNIT

Commander O_2 Probe

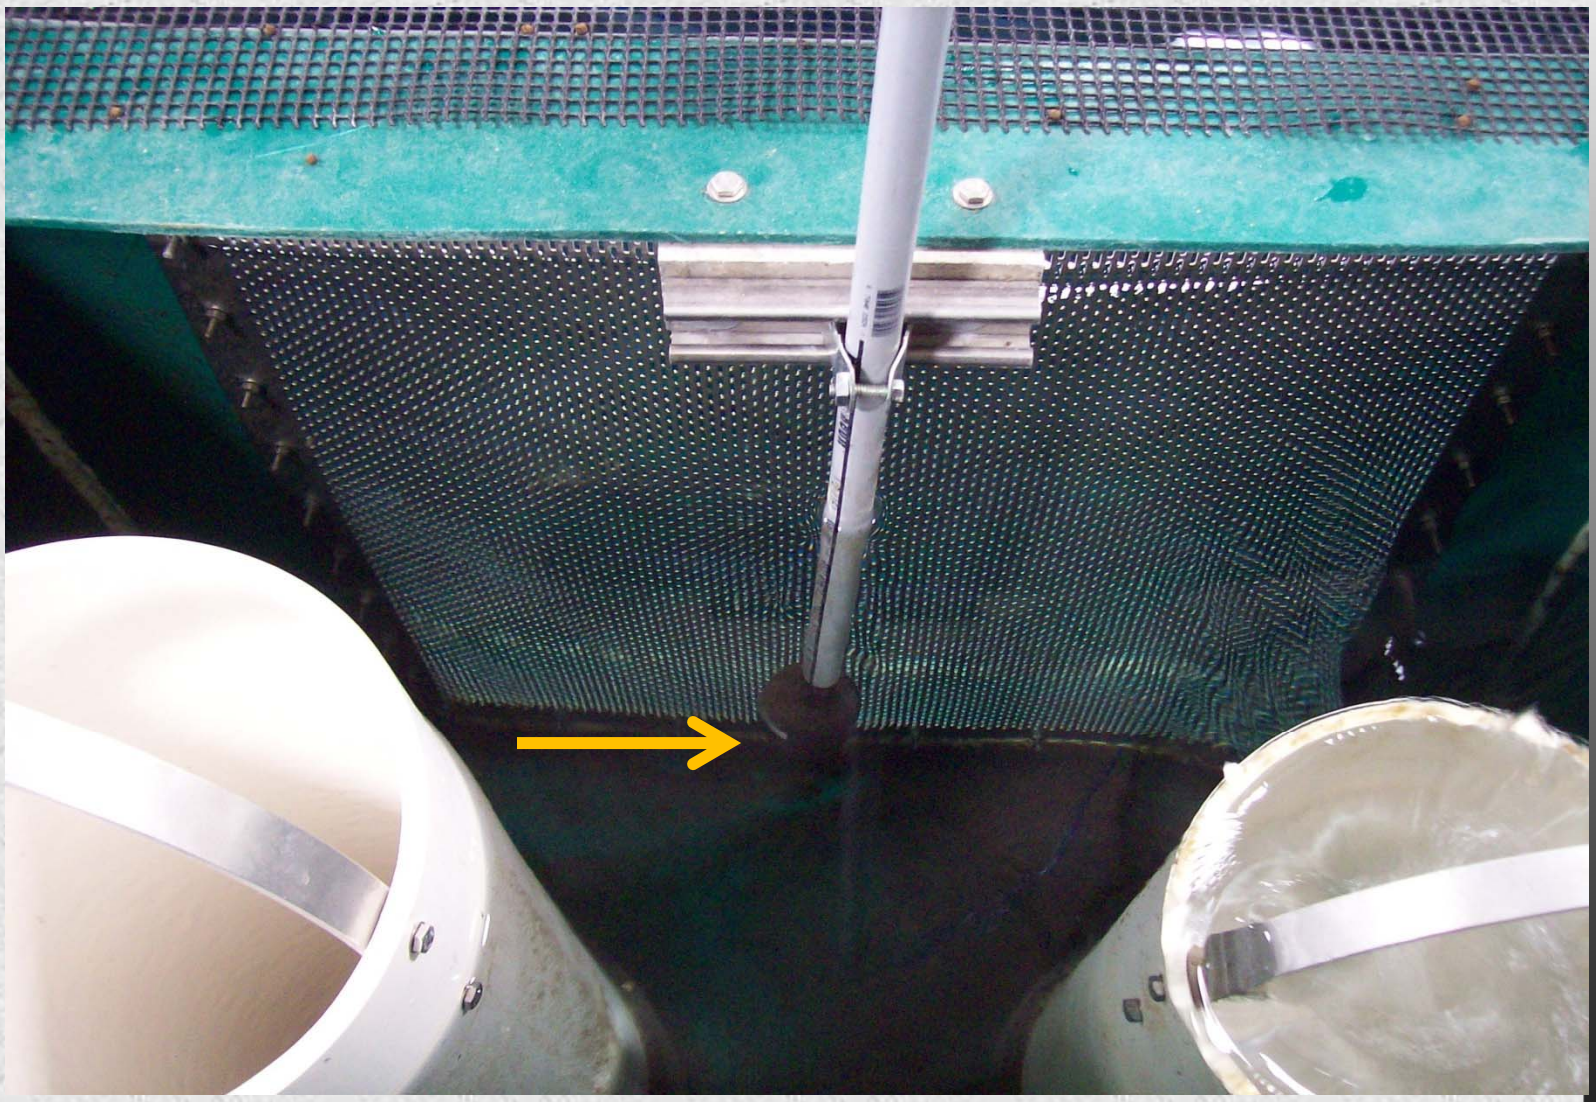

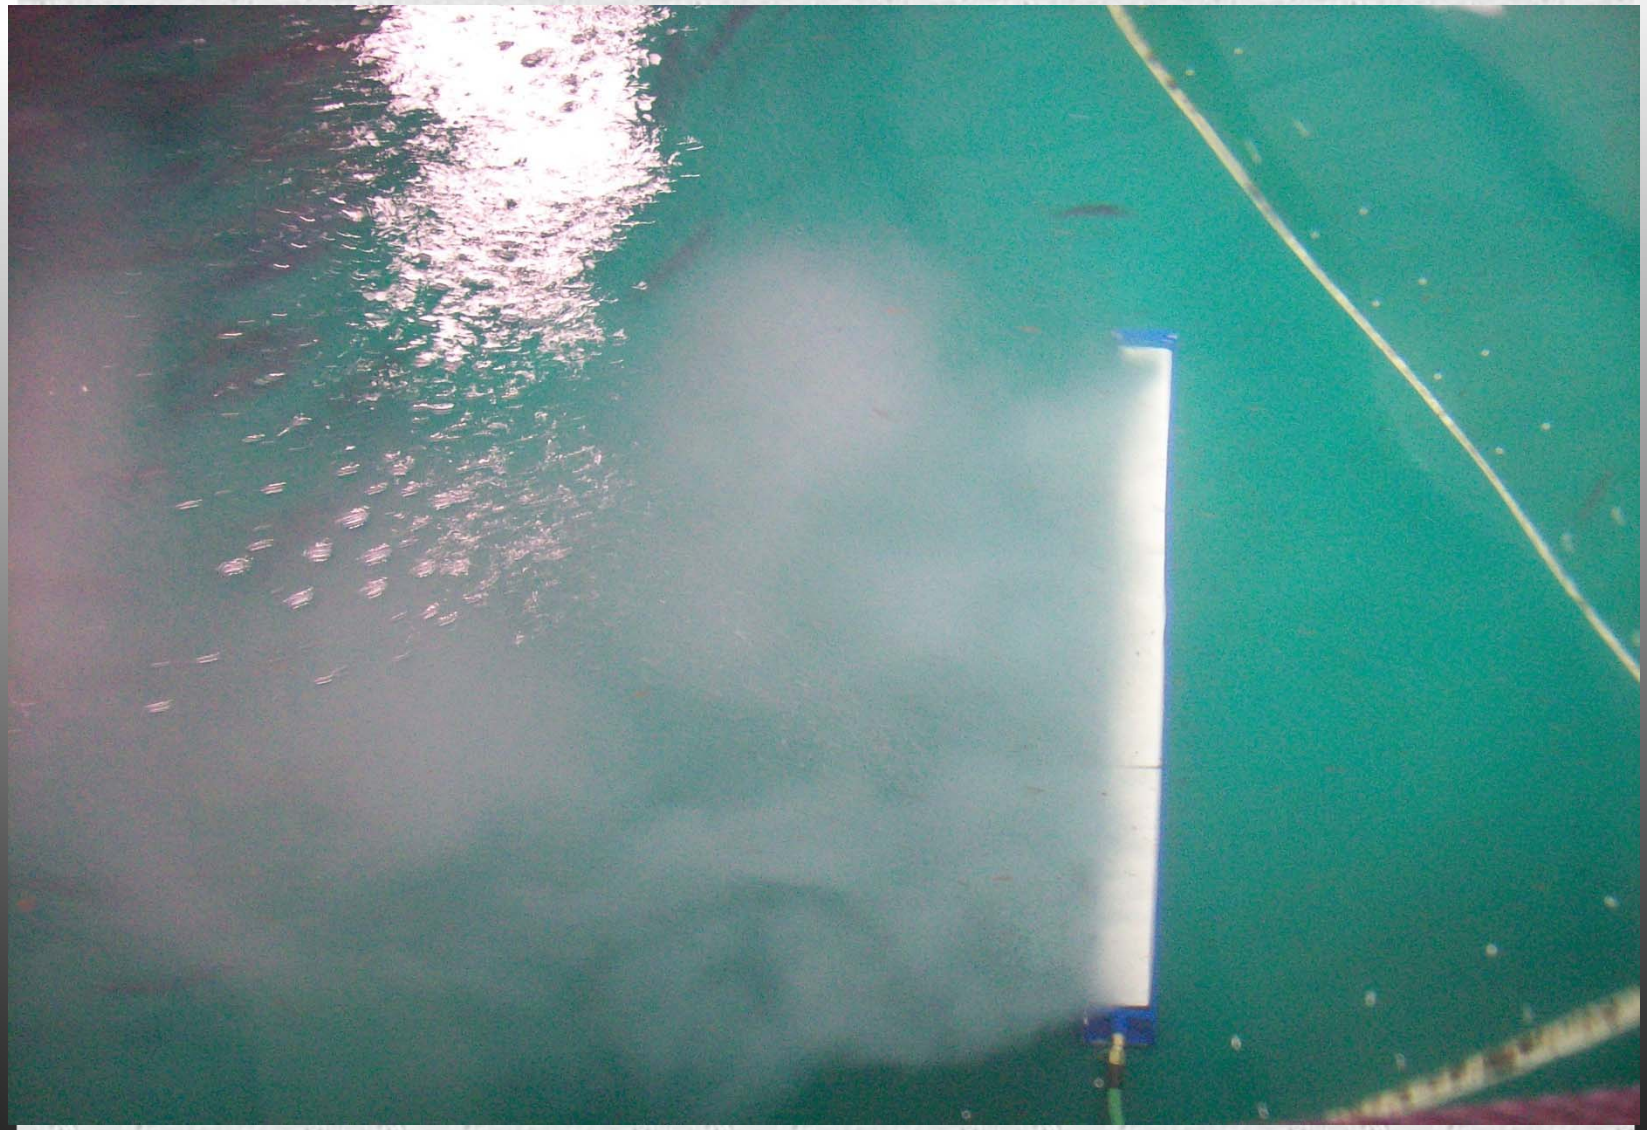

Need a Data Logger For Alarms

Drum Filter

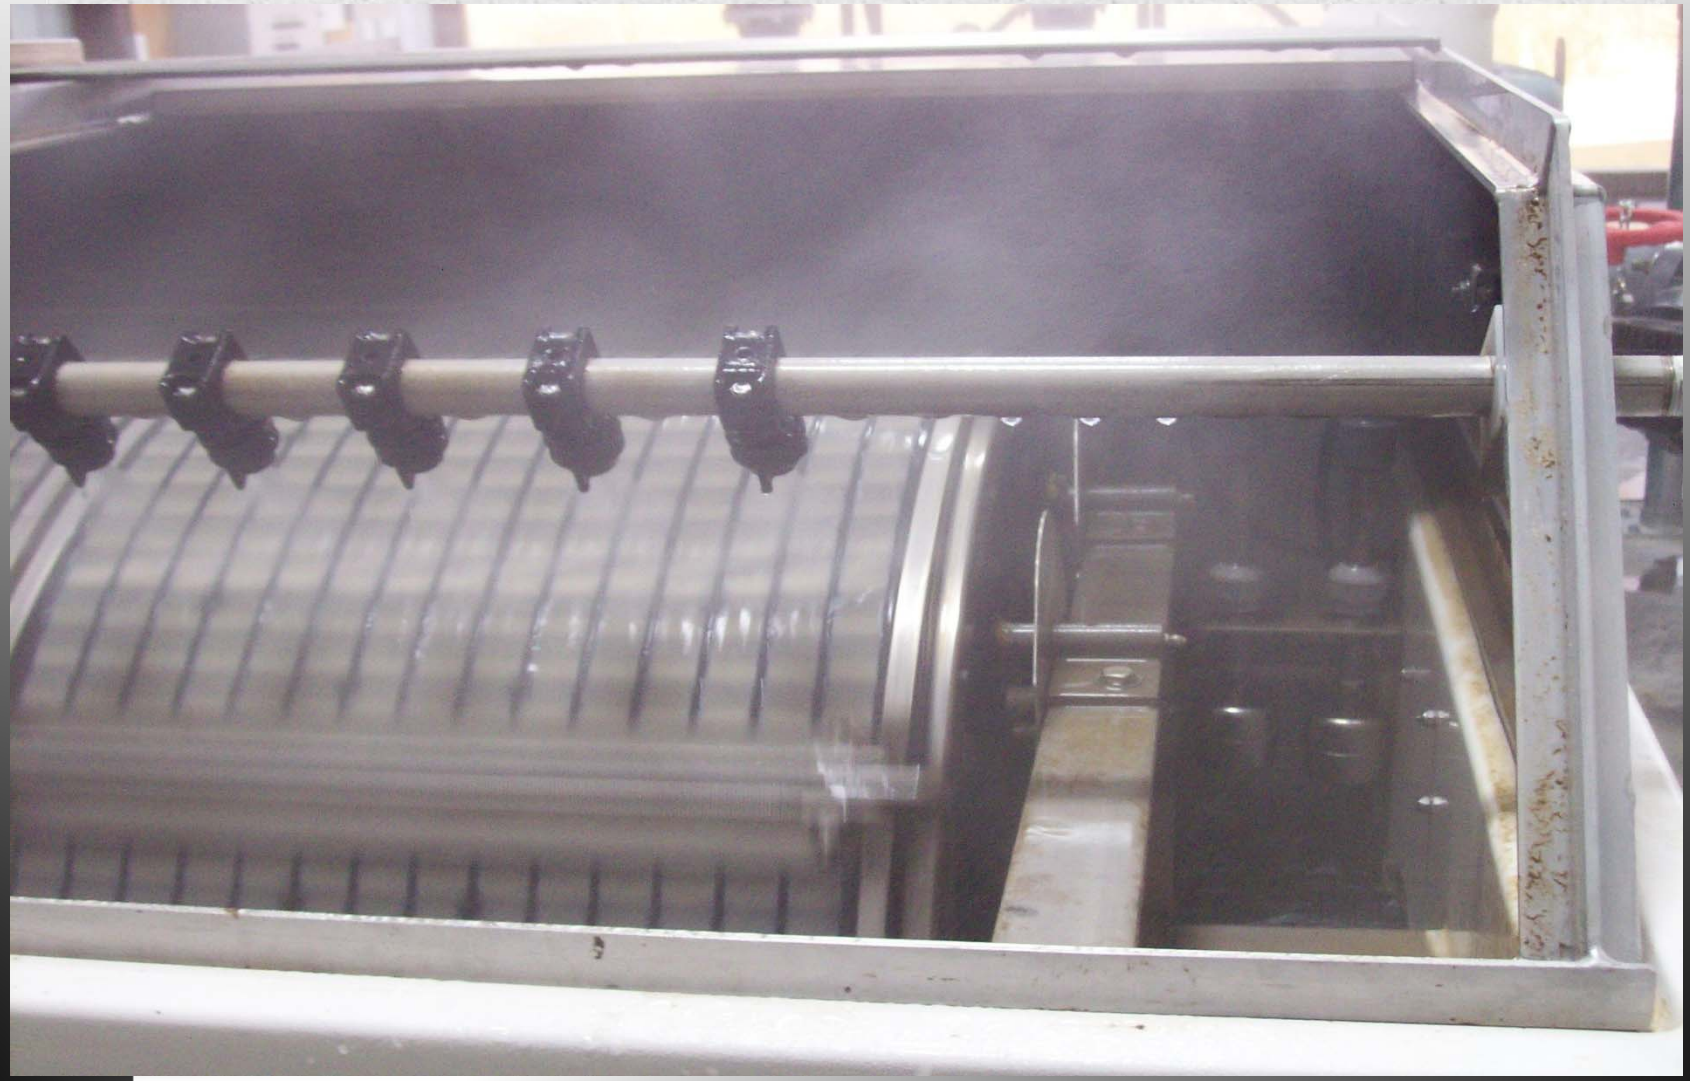

Temporary Fix for LHO Leaks

What Could Cause LHO Overflow

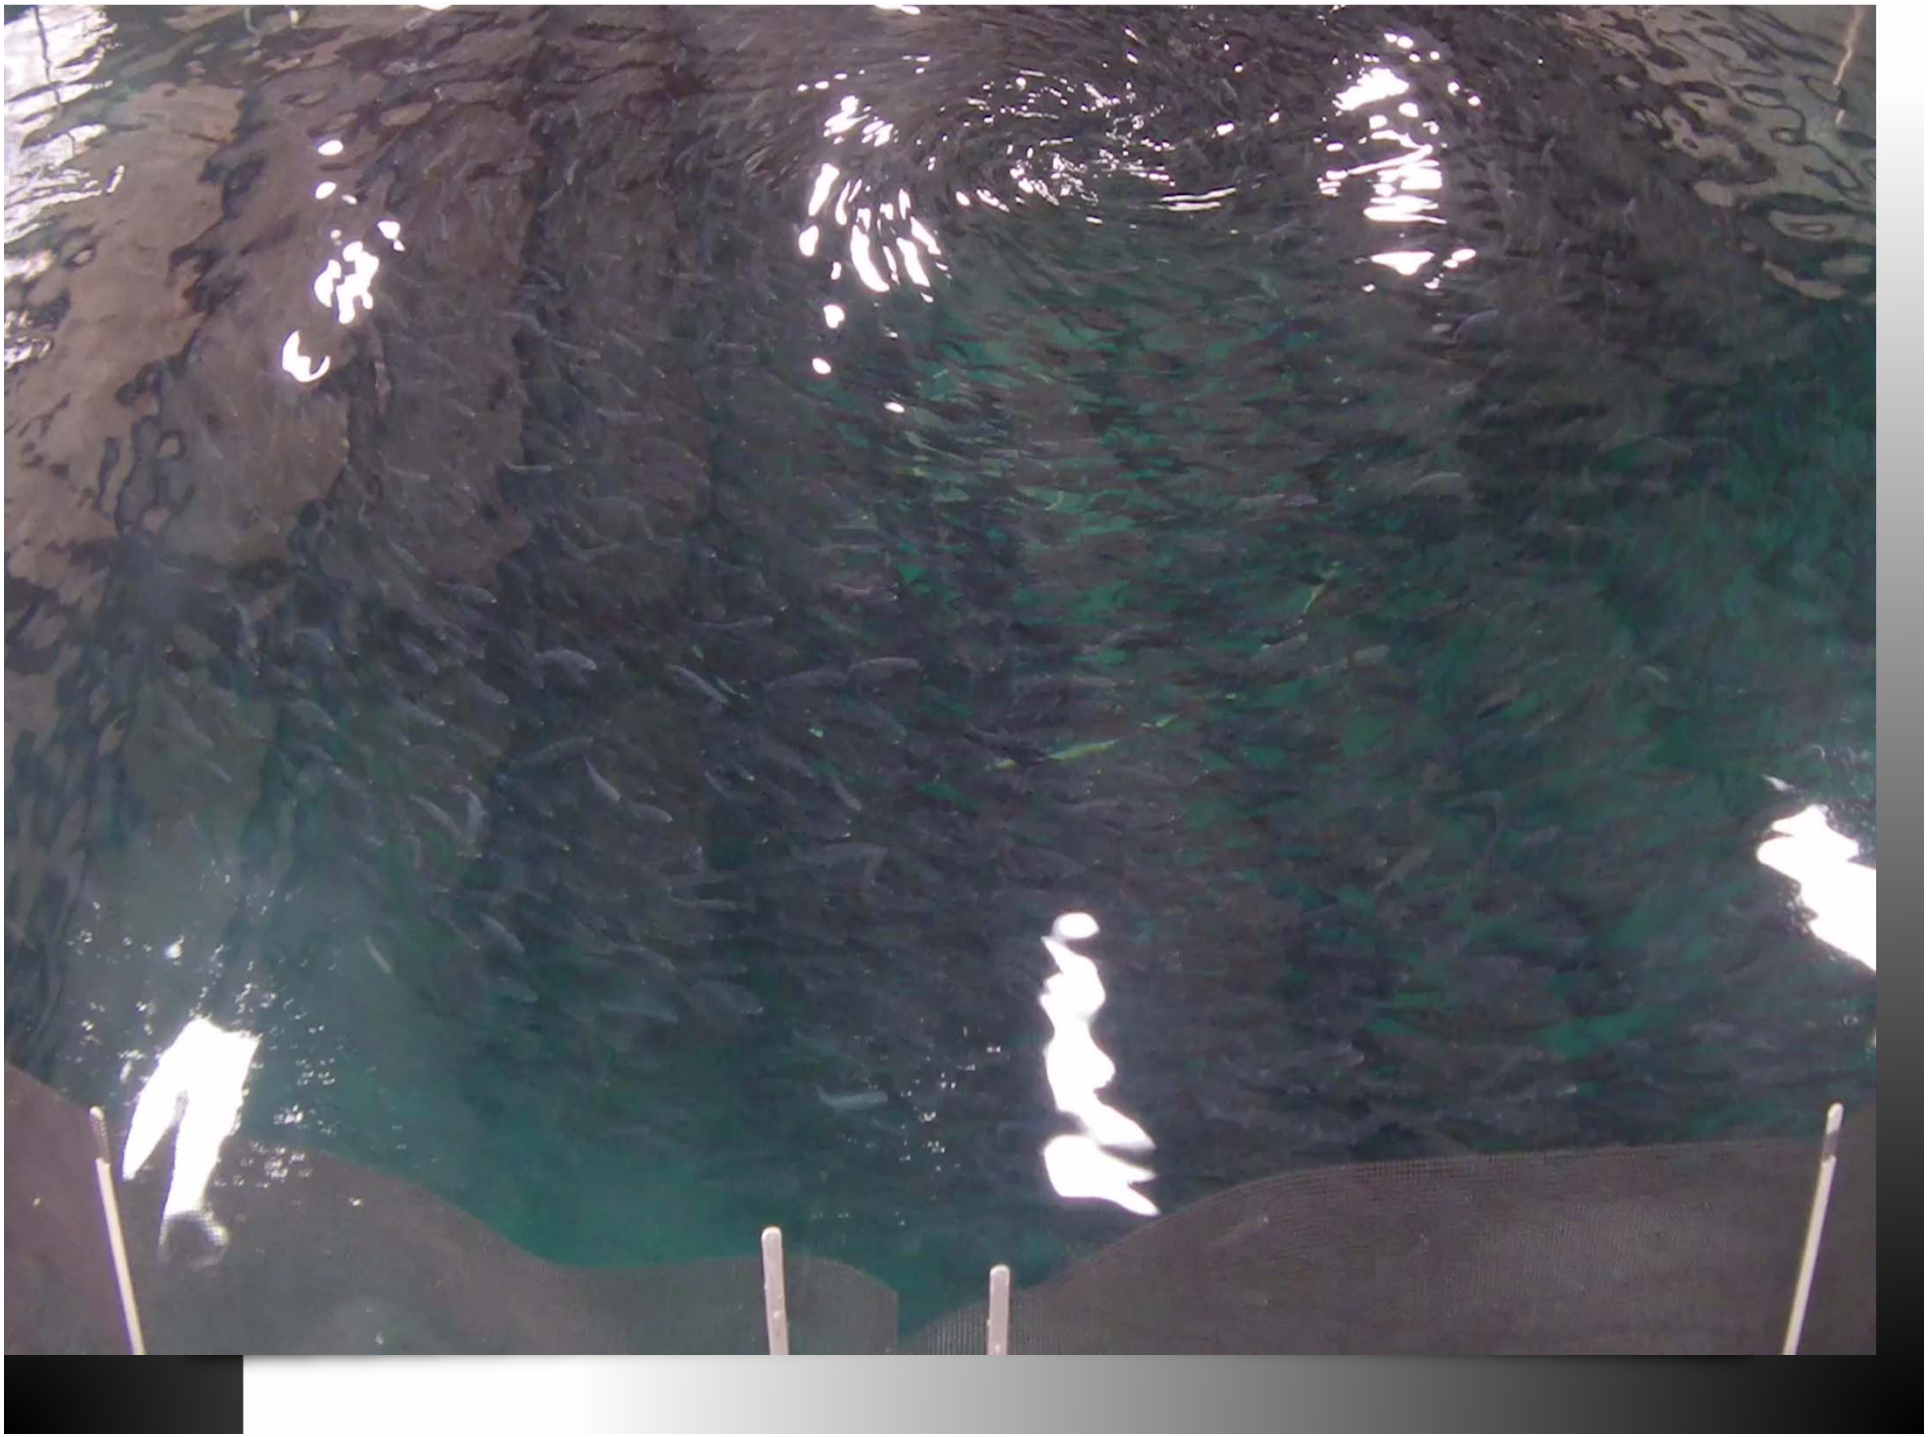

Questions?