


NORTH

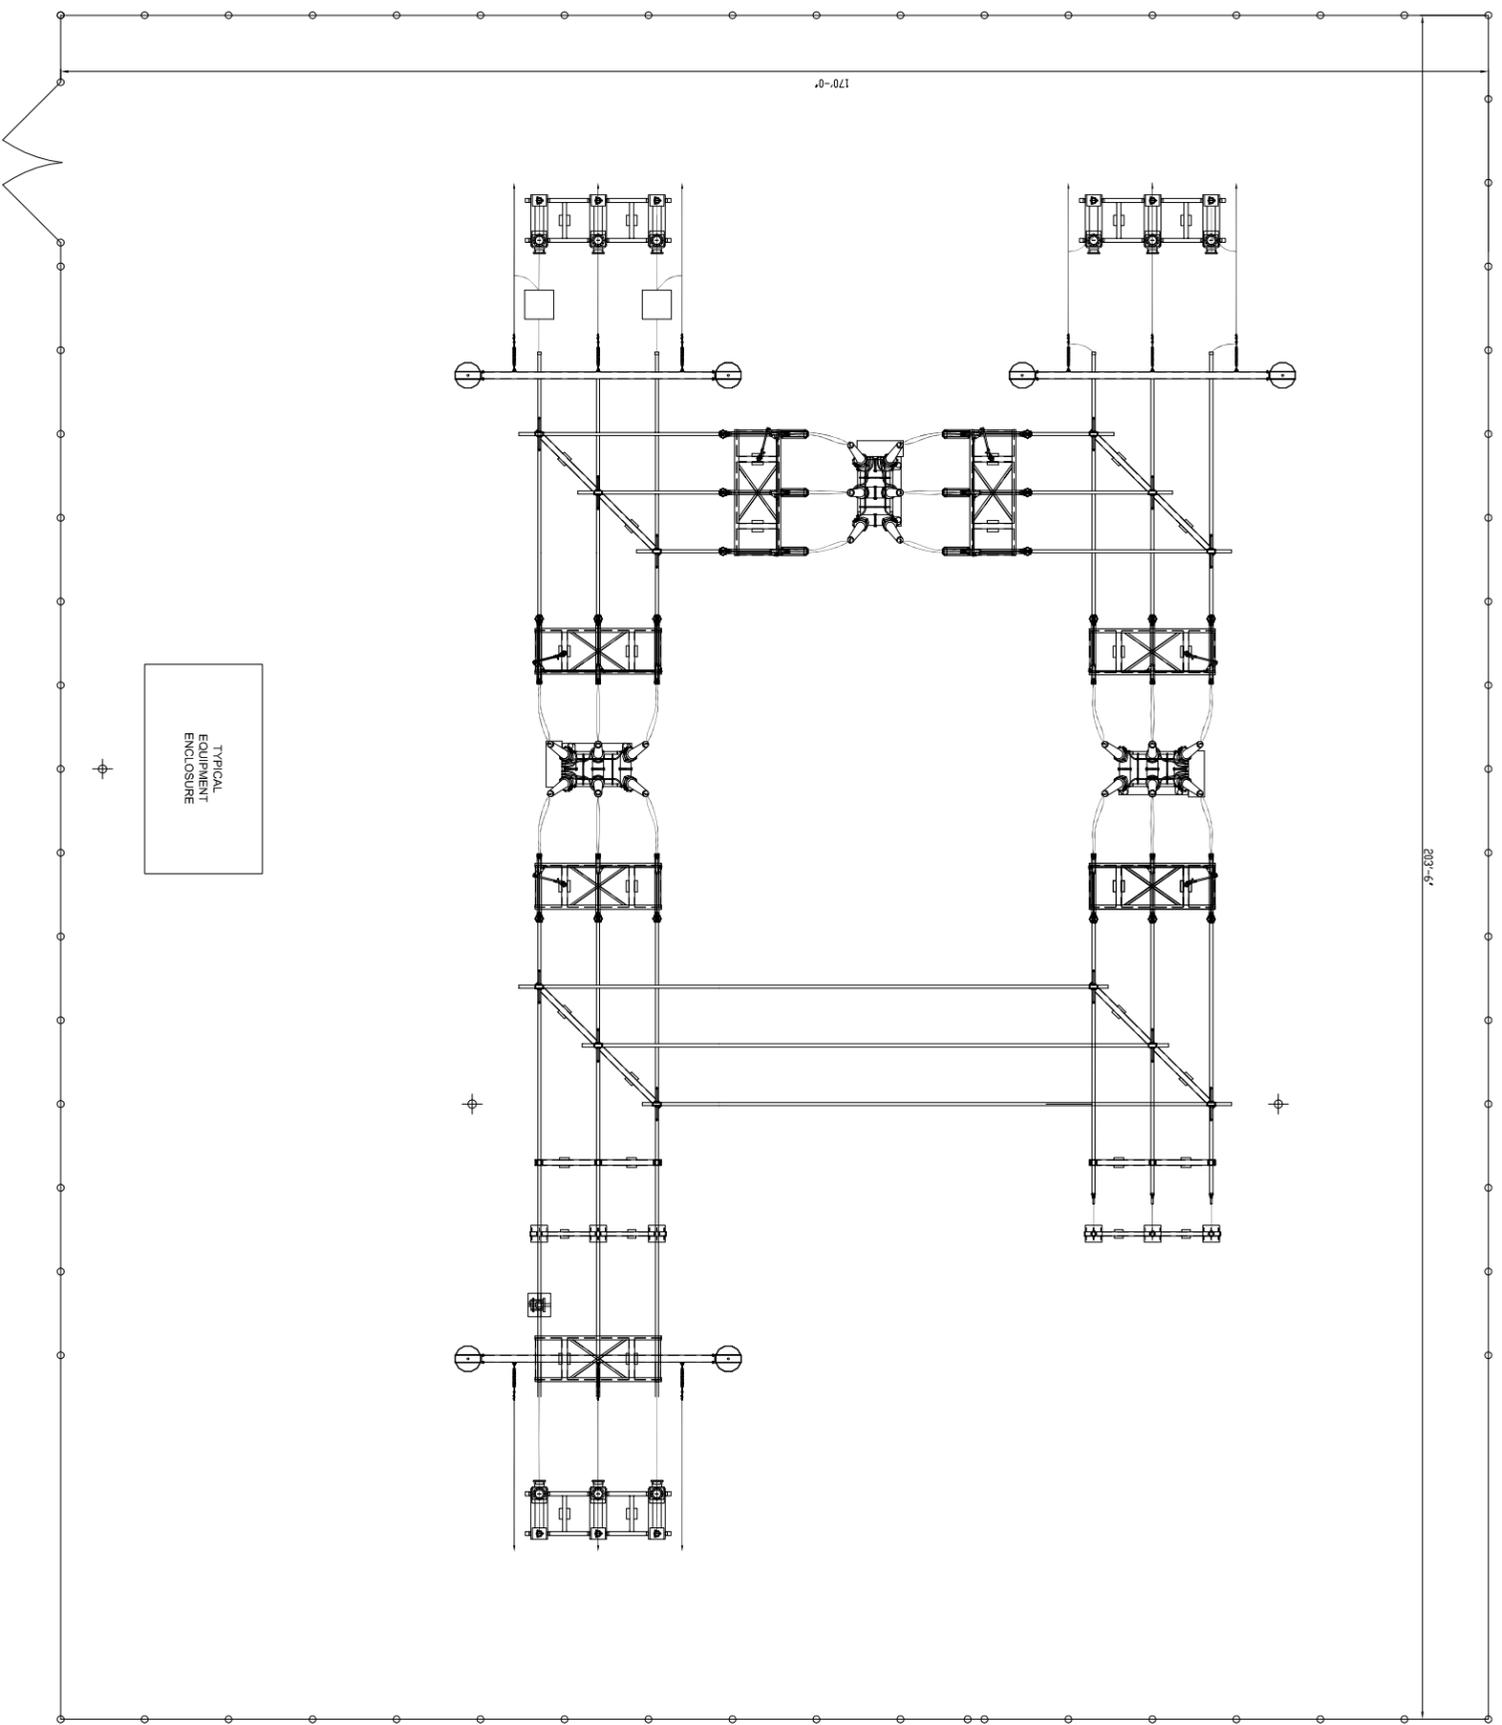

203'-6"

170'-0"

TYPICAL
EQUIPMENT
ENCLOSURE

LEGEND	
— x — x —	SUBSTATION FENCE
⊕	DISCONNECT SWITCH OPERATOR
DESIGN CRITERIA	
115KV CLEARANCE (650KV BIL):	
LIVE PARTS:	MIN ⌀-G = 42"
	MIN ⌀-Ø (METAL TO METAL) = 53"

NO	DATE	REVISION	BY	CHK'D	APP'D

**PRELIMINARY
DRAWING
NOT FOR
CONSTRUCTION**

COPENHAGEN WIND FARM
LEWIS COUNTY, NEW YORK

TYPICAL 115KV POI SUBSTATION GENERAL ARRANGEMENT PLAN VIEW		REV
DRAWN DATE	SCALE	DRAWING NUMBER
5/3/22 = 1'-0"		101-02
		A

CONFIDENTIALITY STATEMENT: THE ABOVE DRAWINGS, CALCULATIONS, IDEAS, DESIGNS AND ARRANGEMENTS REPRESENTED THEREBY ARE AND SHALL REMAIN THE PROPERTY OF COPENHAGEN WIND FARM, LLC AND NO PART THERE OF SHALL BE COPIED, DISCLOSED TO OTHERS, OR USED IN CONNECTION WITH ANY WORK OR PROJECT OTHER THAN THE SPECIFIC PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND DEVELOPED WITHOUT THE EXPRESSED WRITTEN CONSENT OF COPENHAGEN WIND FARM, LLC. VISUAL CONTACT WITH THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE CONCLUSIVE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.