

California Condor Electrical Power Utility General Conservation Plan

Incidental Take Permitting

Covered Activities:

- Existing Powerlines
- Operations Maintenance

50,000 square miles


Plan Term: 20 years

Minimization

- Making power lines more safe
- Best management practices for O&M

Compensatory Mitigation

- Captive Breeding at 3 to 1 ratio.
- Combination of Captive Breeding (2 to 1 ratio) and Non-lead outreach.

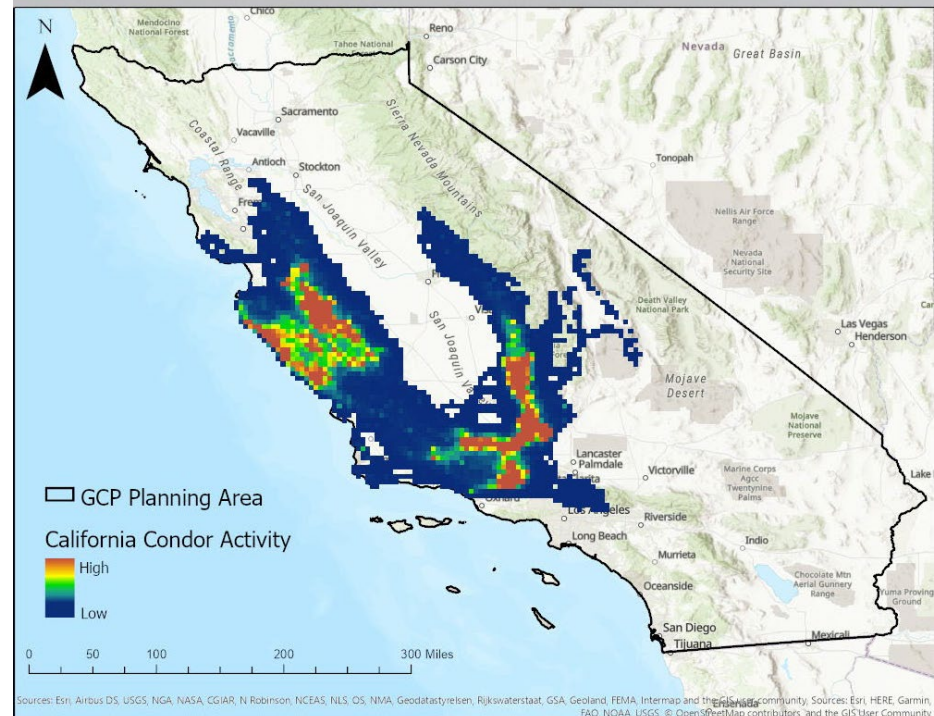

For More Information



Email: joseph_brandt@fws.gov

Phone: (805)677-3324



Ventura
Fish & Wildlife
Office